

# CITY OF ESCONDIDO

## Addendum No.1: RFB No. 22-01 – Grand Avenue Street Light Fixtures

### Bid Opening Date Remains July 22, 2021 2:00pm

*To all holders of Specifications for the RFB No. 22-01 – Grand Avenue Street Light Fixtures: The following revision has been made to the project and shall be included as part of any Bid proposal.*

#### CHANGES TO THE RFB DOCUMENT:


1. ADD the following, “If a discrepancy is found among the contract documents, the RFB 22-01 – Grand Avenue Street Light Fixtures document shall hold precedence over the Construction Plans for Grand Avenue Vision Project, 100% Submittal, Sheets 1 through 27.” to RFB No. 22-01 – Grand Avenue Street Light Fixtures, Page 2 **Standards, Specifications, and Qualifications**
2. REMOVE the following, “1. Poles and Appurtenances, 10-year warranty;” from RFB No. 22-01 – Grand Avenue Street Light Fixtures, Page 5 **Guarantees and Warranties** section.
3. ADD the following, “Street light poles shall be provided with one (1) 20 amp, tamper and weather resistant GFCI receptacle supplied with weather proof cover. Elevation of receptacle shall be between 40” to 50” from base plate, final elevation to be coordinated and approved by the City. The receptacle shall be orientated on the East side of all light poles to align with the planter basket mast.” to RFB No. 22-01 – Grand Avenue Street Light Fixtures, Page 2 **Standards, Specifications, and Qualifications, 1. Street Light Poles**
4. ADD the following, “Bidder shall supply single gang handhole and grommet/cover free of burrs for Festoon Lighting connection cable” after sentence, “Festoon lighting shall be PRIMUS LIGHTING DECOSTRING DSW-36-120V-S14-27/150 Festoon Lighting or approved equal, as depicted in Exhibit 2.” to RFB No. 22-01 – Grand Avenue Street Light Fixtures, Page 3 bullet point four.
5. REPLACE the following, “3.5-feet” with “5.66-feet” for the maximum sag of the Festoon lighting within RFB No. 22-01 – Grand Avenue Street Light Fixtures, Page 3 bullet point four of the fourth sentence.
6. REPLACE the following, “12-feet” with “11-feet” for the street light pole banner connection points and banner arm elevation within RFB No. 22-01 – Grand Avenue Street Light Fixtures, Page 3 bullet point seven.
7. ADD the following, “Steel poles and appurtenances shall be galvanized per ASTM A143/143M, A384/A384M, A385/A385M, B6, A123/A123M, A780, and D6386” to RFB No. 22-01 – Grand Avenue Street Light Fixtures, Page 3, bullet point 2, **Standards, Specifications, and Qualifications, 1. Street Light Poles**
8. REPLACE the “PRICING FORM” section of RFB No. 22-01 – Grand Avenue Street Light Fixtures with this ADDENDUM NO. 1: RFB NO. 22-01 – GRAND AVENUE STREET LIGHT FIXTURES PRICING FORM requesting Alternate pricing.

#### CHANGES TO THE DRAWINGS:

1. Sheets 17, 18, 19, and 20 have been reissued as replacements.
2. Sheet 18 of 27

Detail G: light pole height design criteria, revised note for Festoon lighting fused disconnect,  
and revised note for Festoon lighting 16' minimum above finished grade.  
Detail I: light pole ground details

*Revisions Approved by:*

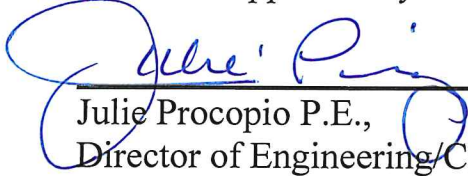

---

Julie Procopio P.E.,  
Director of Engineering/City Engineer

Date: July 14, 2021

*The undersigned acknowledges receipt of Addendum No. 1 and has included same in the proposal. Bidder shall sign this and all other addenda, and this and all other addendums shall be physically attached to the bid package submitted prior to the time of the bid opening. Failure to do so may result in the bid being deemed unresponsive.*

**RECEIPT ACKNOWLEDGED:**

---

*Signature*

*Date*